


HYDRANT MOUNTED RP BACKFLOW ASSEMBLY AND WATER METER

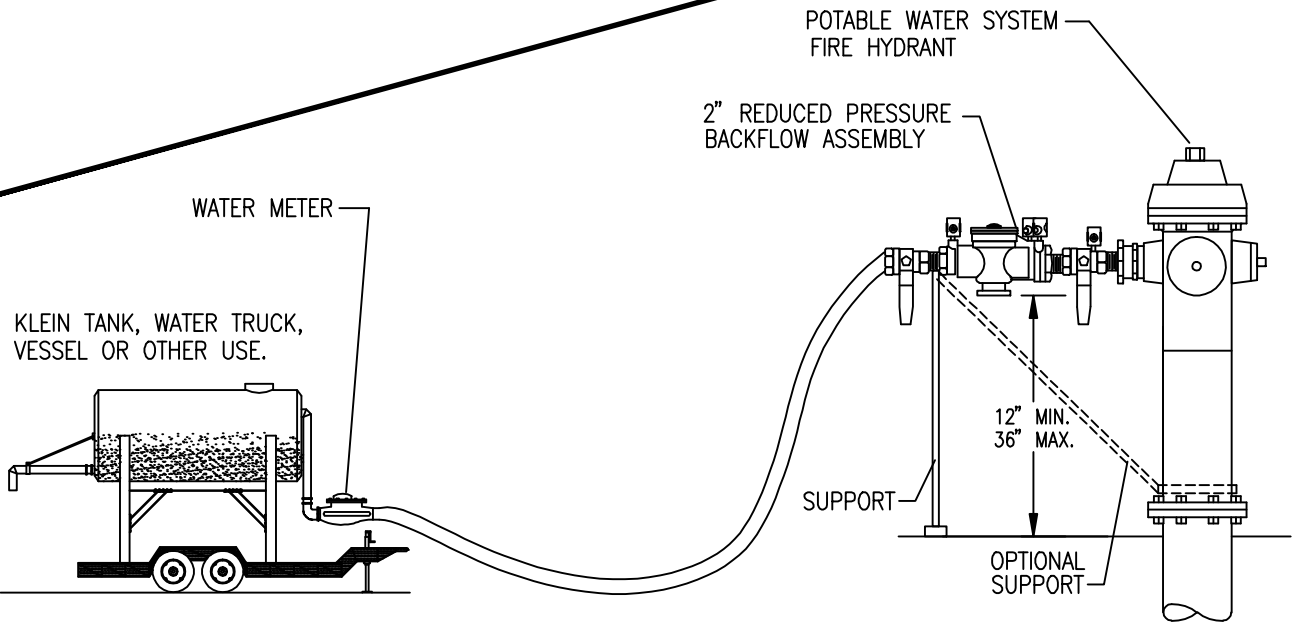

HYDRANT MOUNTED RP BACKFLOW ASSEMBLY AND REMOTE METER

Notes:

1. All backflow assemblies shall be installed, maintained and tested in accordance with regulations.
2. Only one connection per hydrant is allowed unless otherwise authorized by Tucson Water.
3. For a list of approved backflow assemblies or further information contact the Backflow Section at 520-791-2650.

ISSUED:		<b>STANDARD DETAIL BACKFLOW PREVENTION FOR POTABLE WATER FIRE HYDRANT OR STANDPIPE WATER SERVICE</b>		DETAIL NO.
8/00				SD-1801
REVISED:				SHEET 1 OF 1
8/01				