


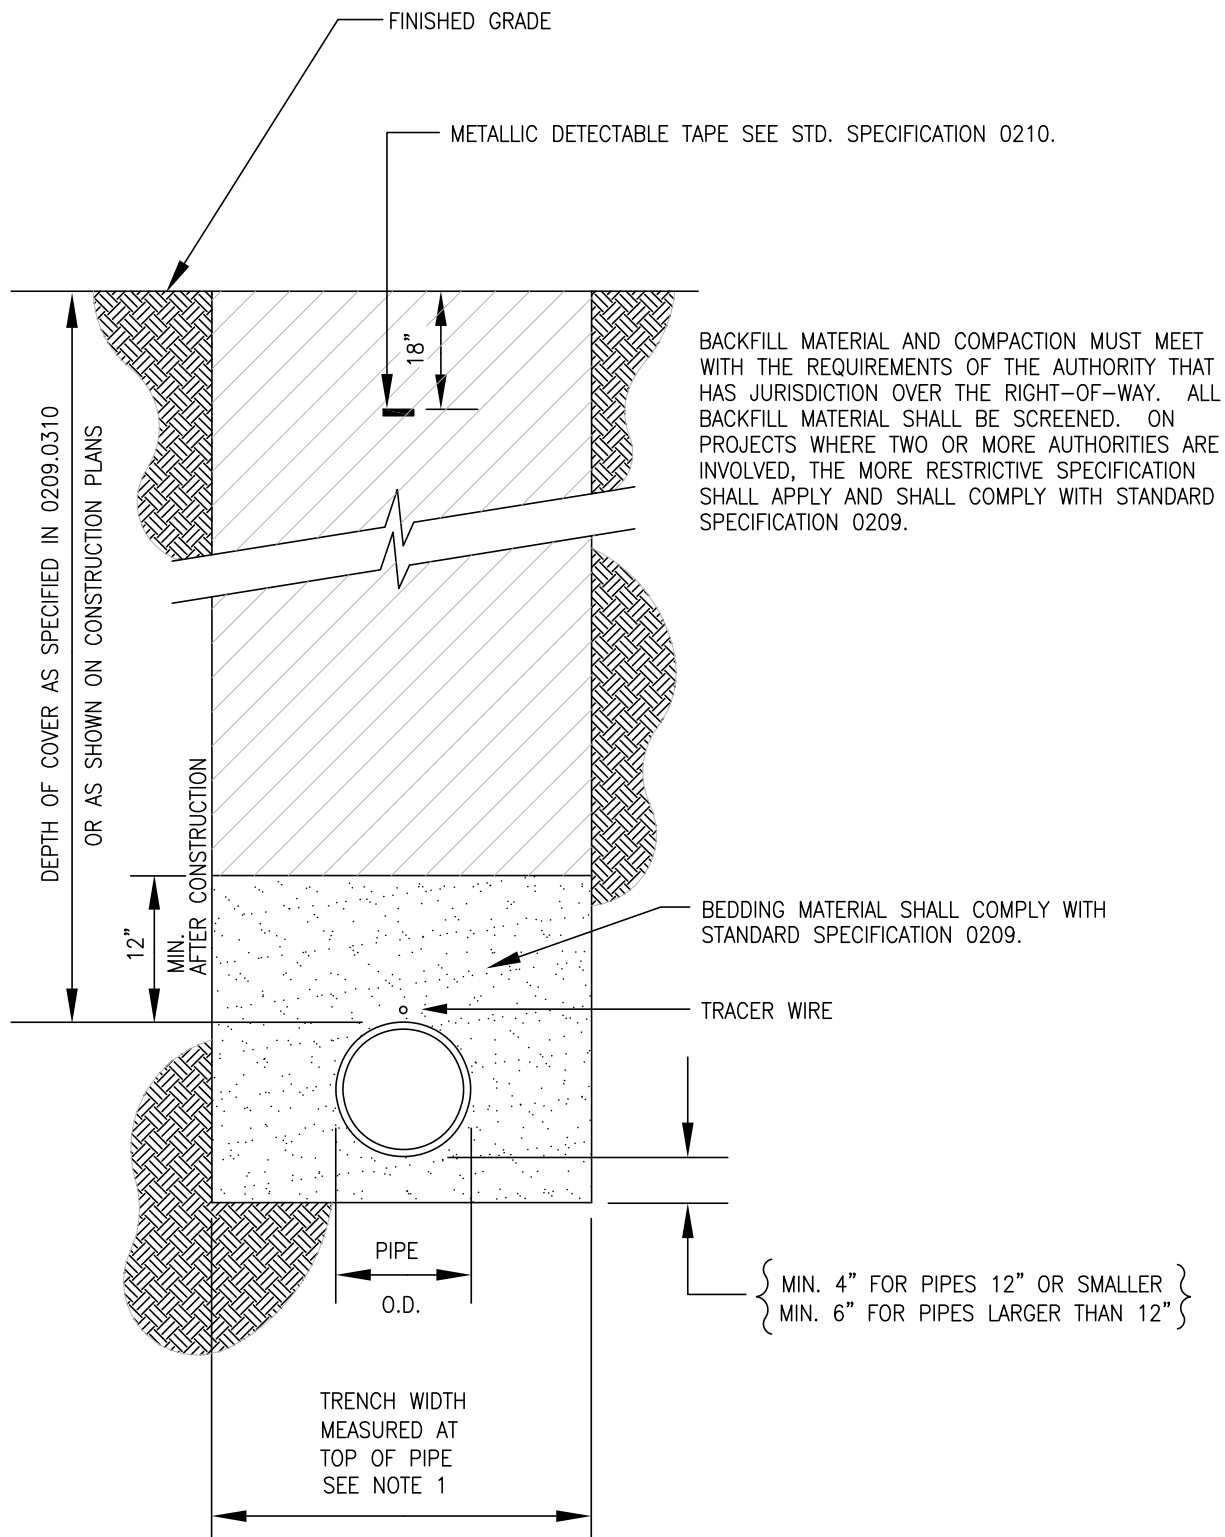

1. TRENCH WIDTH MEASURED AT THE TOP OF THE PIPE SHALL BE 18" FOR 4" AND 6" MAINS AND 24" FOR 8" MAINS. TRENCH WIDTH FOR 12" AND LARGER SHALL BE O.D. + 18" MIN., O.D. + 24" MAX, OR PER OSHA REQUIREMENTS.
2. BEDDING MATERIAL SHALL BE ACTUAL TRENCH WIDTH (BANK TO BANK)
3. PAVEMENT PATCHING SHALL CONFORM WITH THE REQUIREMENTS OF THE PIMA ASSOCIATION OF GOVERNMENTS

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		PIPE BEDDING AND TRENCH BACKFILL		SD-115
REVISED:				SHEET 1 OF 1
2/16				