

SECTION 1203

CENTRIFUGAL BOOSTER PUMP & MOTOR

1203.0100 GENERAL

1203.0101 Description of Work. The work under this section shall consist of furnishing all labor, materials, equipment, and appurtenances required for the installation and testing of centrifugal booster pumps and motors, in accordance with the details shown on the plans, special specifications, and the requirements of these specifications.

It is the intent of these specifications to obtain a high efficiency, durable, centrifugal pump and motor of heavy duty construction for continuous service or for intermittent service, whichever imposes the most severe conditions on the pump. Pumps that have mechanical defects or do not meet the range or head-capacity characteristics, horsepower, efficiency requirements will be rejected after testing and shall be replaced without additional cost to the Owner for furnishing, removal, reinstallation, and retesting. Mechanical defects shall include the following;

- Excessive vibration
- Improper balancing of any rotating parts
- Improper tolerances
- Binding
- Excessive bearing heating
- Defective materials, including materials that do not conform to the specifications
- Improper fitting of parts
- Any other defect which will in time damage the pump or unreasonably impair the efficiency of the pump

1203.0102 Related Specifications.

Section 0106 - Control of Material of the standard contract conditions.

1203.0103 Submittals. Five sets of shop drawings and literature shall be submitted for each centrifugal booster pump and motor. All submittals and copies thereof shall be clean, legible prints that are easily reproduced and shall reference the project name and plan number. Shop drawings and literature together with an assembly drawing showing the entire pump and motor assemblies shall include detailed specifications and drawings indicating:

- (A) **Pump**
- Pump curves and literature (See list below)
 - Manufacturer
 - Model and number of stages
 - Design full-load speed
 - Nominal size
 - Design speed
 - Component materials
 - Any other noteworthy design features

The pump performance curve and literature, for the specific impeller diameter and number of stages, for the entire operating range of the pump including shut-off head, shall include:

SECTION 1203

- (1) A head-capacity curve with design point indicated
- (2) A horsepower requirement curve
- (3) An efficiency curve
- (4) A NPSHR curve
- (5) Impeller type, part number, and diameter
- (6) Dimensioned assembly drawing detailing the entire centrifugal booster pump and motor

See sample pump curve at end of section for proper plotting of data and information required. Failure to comply with these requirements will result in rejection of the submittal.

(B) Motor

- Manufacturer
- Model
- Horsepower
- Rated rpm
- Efficiency
- Full load amps
- Dimensioned assembly drawing
- Certified performance data as follows:

The motor shall have short commercial tests performed which include: no load current, locked rotor current, winding resistance, high potential, and vibration and bearing inspection. Certified copies of test reports on the short commercial test performed on a comparable motor shall be submitted for review as part of the shop drawing submittal. Certified performance data, in the form of a computer analysis, or a complete initial test on a motor comparable to the one being provided, shall be submitted for review as part of the shop drawing submittals. The complete initial test data for a comparable motor shall include, but not be limited to: full load heat rise, percent slip, breakdown torque, and locked rotor torque, efficiency, power factor at full, 3/4, and 1/2 load.

1203.0104 Delivery, Storage, and Handling. Centrifugal booster pumps and motors shall be delivered to the site, stored and handled in accordance with the manufacturer's instructions except as may be modified by the plans, special specifications, or as directed by the Engineer. The equipment shall be packaged, shipped and handled in such a manner that no damage will result to any component. Precaution shall be exercised in handling so as to avoid imposing strain on any part of the pump and motor.

1203.0200 PRODUCTS

1203.0201 Materials.

(A) **Pump.** The pump(s) furnished shall comply with the capacity and minimum working pressure noted on the plans or in the special specifications. The pump shall be of integral horsepower, single suction, end suction type, either flexible or close-coupled.

Pump performance characteristics shall be as noted on the plans or in the special specifications and shall include the following:

Design capacity (gallons per minute)

SECTION 1203

Design total pumping head (pump lift in feet)
Minimum allowable lab efficiency (%) at Design Point.
Minimum operating pumping head (pump lift in feet)
Minimum allowable lab efficiency (%) at minimum operating pump head
Minimum shut-off head (feet)
Rated rpm
NPSH required
Minimum horsepower

The casing shall be constructed of smooth grained cast iron. Each unit shall be base mounted, ready for pad mounting and the pump and electric motor assembly aligned prior to shipment to the site. The casing shall be designed to permit disassembly from the rear to remove pump internals without disturbing the system piping. The casing shall be NPT tapped and plugged at two locations, 1/2" maximum.

Flanged casing nozzles shall conform to ANSI B16.1 with a minimum 125 psi rating. All flanged connections shall be flat face.

(1) **Mechanical Seal.** Each pump shall have a mechanical shaft seal mounted on a stainless steel or bronze sleeve. Wearing rings shall be replaceable, positively locking, and shall fit to permit a minimum of recirculation.

(2) **Impellers.** Unless otherwise indicated on the plans or in the special specifications, impellers shall be SAE 40 bronze. Impellers shall be accurately keyed to the pump shaft, and securely fixed.

(B) **Motor.** The pump shall be supplied with a squirrel cage induction motor of the required horsepower. The motor shall operate below motor nameplate full load amps for the entire range of the pump curve on all three phases. Motors 50 hp or larger shall be provided as 6 lead 1/2 – 1/2 part wind motors.

The motor shall be 460 Volts, 3 Phase, 60 Hz. and shall be of guarded, drip-proof construction. The motor shall be rated for continuous duty.

The motor shall be designed, manufactured and tested in accordance with NEMA MG-1 Standards. The following information shall be as indicated in the special specifications and shall be stamped on a permanently affixed engraved stainless steel motor nameplate.

Motor insulation class
Temperature rise class
Ambient temperature rating
Design class
Service factor
Horsepower
Number of phases
Voltage
Frequency
Frame size and type

SECTION 1203

Full load current
Full load RPM
NEMA nominal efficiency
Motor duty cycle (continuous)

The temperature rise of the motor shall be in accordance with the requirements for Class B at a service factor of 1.15. The ambient temperature rating shall be 40° C at a maximum altitude of 3,000 ft. The motor insulation shall be Class F.

The conduit box shall be provided with a grounding terminal. The conduit box shall be sized to handle required conduit and wire.

The motor torque/speed curve shall be NEMA Design B.

The motor windings shall be copper with not less than 98% conductivity.

The nominal motor speed shall be as specified in the special specifications.

The motor shall be capable of continuous operation at full load and rated frequency, with a voltage variation of $\pm 10\%$ above or below the rated voltage, provided the sum of the voltage and the frequency variation does not exceed 10%, with the frequency variation not exceeding 5%.

The motor winding start configuration shall be as specified on the special specifications.

Motor bearings requiring lubrication with grease shall be equipped with zerk type fittings and grease relief plugs.

The motor shall be designed for four starts per hour at an ambient temperature of 40° C when coupled to the pump load specified in the special specifications.

1203.0300 EXECUTION

1203.0301 Installation. Centrifugal pumps shall be furnished as specified by the plans, the special specifications or as directed by the Engineer. Prior to installation, the contractor shall furnish five sets of installation instructions and lubrication instructions for each pump and motor. The instructions shall include detailed information regarding pump adjustment as well as recommendations for the proper type of lubricant

Centrifugal pumps shall be installed and adjusted as specified in accordance with the manufacturer's recommendations and in such a manner that the connecting piping shall not impose any strain on the pump.

1203.0302 Testing. Each pump and motor, unless otherwise specified, shall be field tested for compliance with the head-capacity, efficiency, and horsepower requirements specified. The contractor shall furnish all manpower, facilities, power, and equipment required for conducting all tests. Field tests and manufacturers' tests will be conducted in accordance with the latest requirements of the Hydraulic Institute Standards.

SECTION 1203

Each pump shall be field tested for vibration and alignment after installation. Testing shall be as specified by the special specifications. Field tests shall be conducted using the fluid that the pump was specified for.

Vibration shall be tested with a Starret vibrometer or a vibrometer acceptable to the Engineer.

The vibration limits of pumps shall be as described in the Hydraulic Institute Standards. It shall be the responsibility of the contractor to dynamically balance the pump and motor, and to reinforce, stiffen, or support the pump, frame, or pedestal in order to provide vibration levels within the limits described herein.

Each pump shall be operated by the contractor for as long as required to insure proper installation and operation. Following the operation by the contractor, the Agency will operate the pumps to determine if the pump satisfies all of the performance requirements listed in Subsection 1203.0301. The Contractor shall be responsible for making all adjustments required for proper operation.


The pump shall be capable of operating against a closed discharge valve for not less than two minutes without excessive vibration, binding, rubbing of rotating parts, or damage to pump, motor, or coupling.

The contractor shall provide the service of a fully qualified, factory-trained service representative of the pump manufacturer who shall inspect the installation, initial start up, and testing, and make adjustments as may be necessary for proper operation. The contractor shall make all provisions for the services of the manufacturer's representative for such periods of time as may be necessary to place the unit in satisfactory operating condition. The contractor shall provide three complete sets of operating and maintenance instruction for the pumps/motor unit.

SECTION 1203

SAMPLE PUMP CURVE

- | | |
|----------------------------|-------------------------|
| 1. Manufacturer _____ | 5. Pump Model No. _____ |
| 2. Impeller Diameter _____ | 6. Design GPM _____ |
| 3. Design Head _____ | 7. RPM _____ |
| 4. H.P. _____ | 8. No. of Stages _____ |

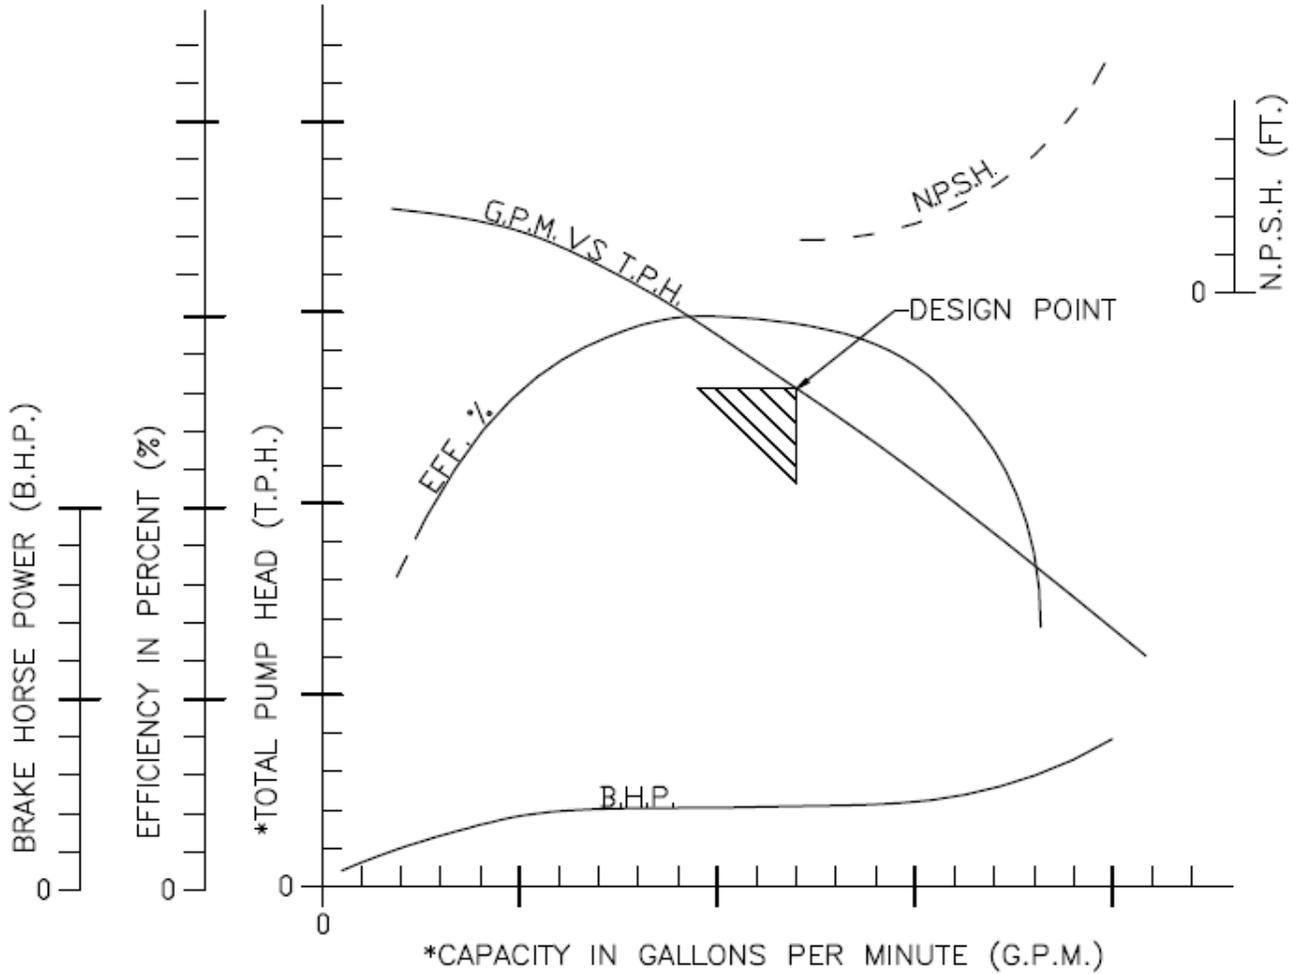

* Range of capacity (GPM) and Total Pump Head (TPH) shall be of the size to properly demonstrate the pump operational characteristics throughout the entire pumping range of the pump. Failure to do so will result in rejection of the pump curve.