


TUCSON WATER OWNED AND MAINTAINED WATER METER WITH TUCSON WATER OWNED AND MAINTAINED RP BACKFLOW ASSEMBLY

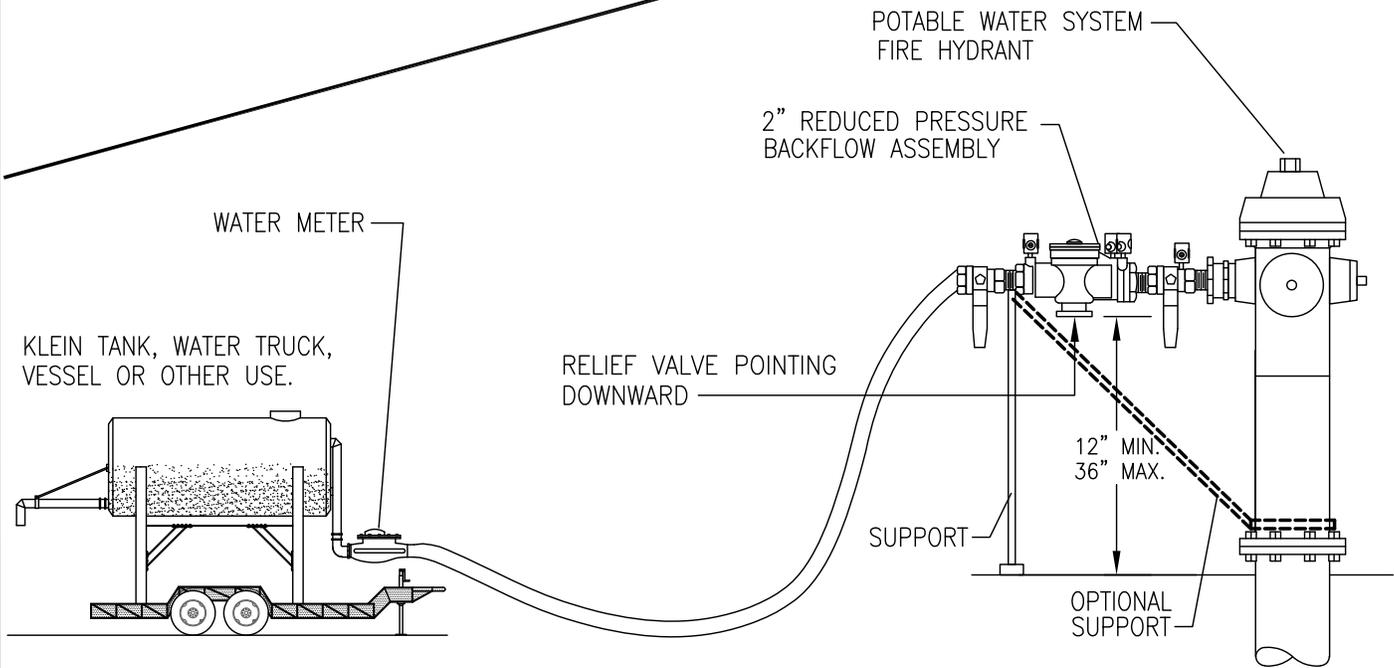

CONTRACTOR OWNED AND MAINTAINED WATER METER WITH CONTRACTOR OWNED AND MAINTAINED RP BACKFLOW ASSEMBLY

Notes:

1. All backflow assemblies shall be installed, maintained and tested in accordance with regulations.
2. Only one connection per hydrant is allowed unless otherwise authorized by Tucson Water.
3. For a list of approved backflow assemblies or further information contact the Backflow Section at (520)791-2650.

ISSUED:		<b>STANDARD DETAIL BACKFLOW PREVENTION POTABLE WATER FIRE HYDRANT OR STANDPIPE WATER SERVICE</b>		DETAIL NO.
8/00				SD-1801
REVISED:				SHEET 1 OF 1
2/17				