

* SPECIFY PIPE MATERIAL

NEW 8" PIPE


STA. 3+00
 1-8"x 6" TEE
 1-6" VALVE, B. & C.
 36' NEW 6" PIPE *
 1-6" FIRE HYDRANT

STA. 4+45
 1-8"x 8" TEE
 1-8" VALVE, B. & C.
 STUB AND BLOCK FIRE
 SERVICE LINE PER SD-500

NOTES:

1. Details as shown reflects the minimum amount of information which shall be required prior to acceptance of plans. Coordinate with Tucson Water for additional requirements.
2. Bearings and distances shall be shown on the plans exactly as described in the legal descriptions. Plans shall also show the "true point of beginning" per the legal description.
3. For fire services, SEE SD 500, SHEET 4 OF 8.


ISSUED:		STANDARD DETAIL SYSTEM INSTALLATION OUTSIDE PUBLIC RIGHT-OF-WAY		DETAIL NO.
6/97				SD-340
REVISED:				
4/13				SHEET 1 OF 2

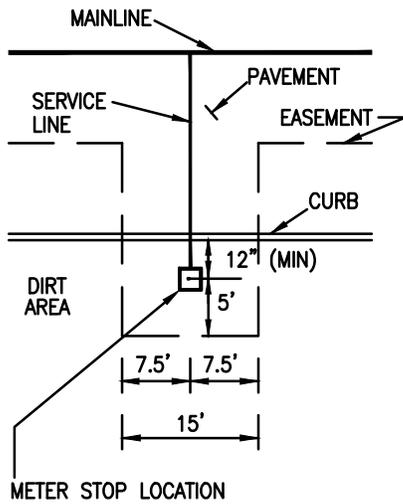


DETAIL A
(NORMAL INSTALLATION)

ANGLE METER STOP LOCATION SHALL BE INSTALLED ADJACENT TO BACK OF CURB IN SIDEWALK. SET METER BOX AND COVER FLUSH WITH SIDEWALK. PLACE BITUMINOUS MATERIAL BETWEEN METER BOX AND CONCRETE SIDEWALK.

METER LOCATIONS IN PAVED AREAS ARE TO BE AVOIDED. WHEN NECESSARY HOWEVER; THE METER BOX SHALL BE CAST IRON OF THE APPROPRIATE SIZE AND PLACED OUTSIDE TRAVELED AREAS, PARKING AREAS, OR LOADING RAMPS.

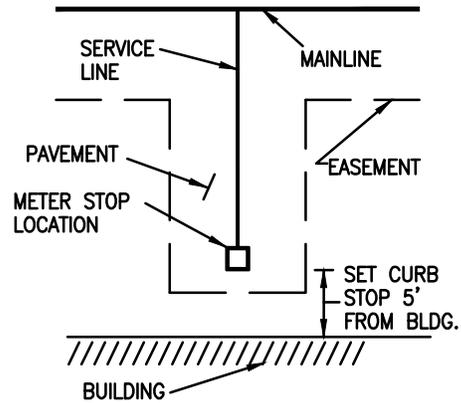


DETAIL B
(IN PAVEMENT BEHIND BUILDING WITHOUT CURB OR SIDEWALK)

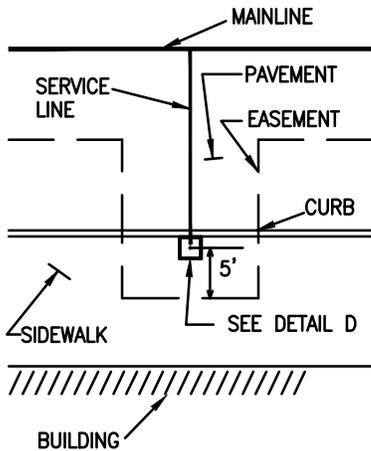

DETAIL C
(FOR INSTALLATION BEHIND CURB IN SIDEWALK AREA)

METER BOX LOCATION (GENERALLY IN SHOPPING CENTERS) WHERE SIDEWALKS ARE JOINING CURB. SET METER BOX AND CAST IRON COVER FLUSH WITH TOP OF CURB AND SIDEWALK. PLACE BITUMINOUS MATERIAL BETWEEN METER BOX AND CONCRETE CURB AND / OR SIDEWALK.

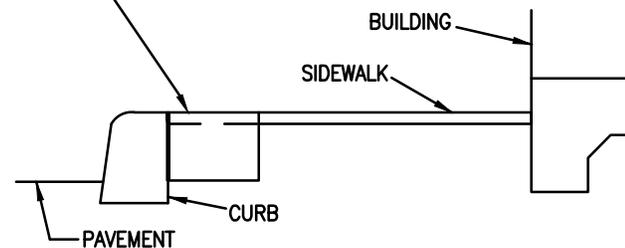

NOTE:
A MINIMUM 5 FOOT STRIP EASEMENT SHALL BE REQUIRED FOR TOWNHOUSE AREAS.

DETAIL D

ISSUED:		STANDARD DETAIL SYSTEM INSTALLATION OUTSIDE PUBLIC RIGHT-OF-WAY		DETAIL NO.
6/97				SD-340
REVISED:				
9/08				SHEET 2 OF 2