


SEE STANDARD SPECIFICATION 0204, 0209, AND SD-105

NOTES:


1. All new pipe and fittings shall be restrained in accordance with Standard Specifications.
2. The minimum restrained joint length shall be as indicated on the plans or per specifications.
3. Existing valves 24 inch and larger shall be salvaged and delivered to Tucson Water. Per SD-105, 26C.
4. All new pipe and fittings shall have a minimum nominal diameter of 4 inches, unless otherwise noted or directed by the engineer.
5. Connect to existing pipeline utilizing a flexible coupling—or as approved. The coupling shall be compatible with the outside diameter of both the new and existing pipe.
6. Fittings with leaded joints shall be removed and replaced as approved by the engineer.
7. Contractor shall schedule water shutdown with Tucson Water Inspector 14 days in advance.
8. Stainless steel repair clamp for water service line shall be a minimum 6” width

NOTES

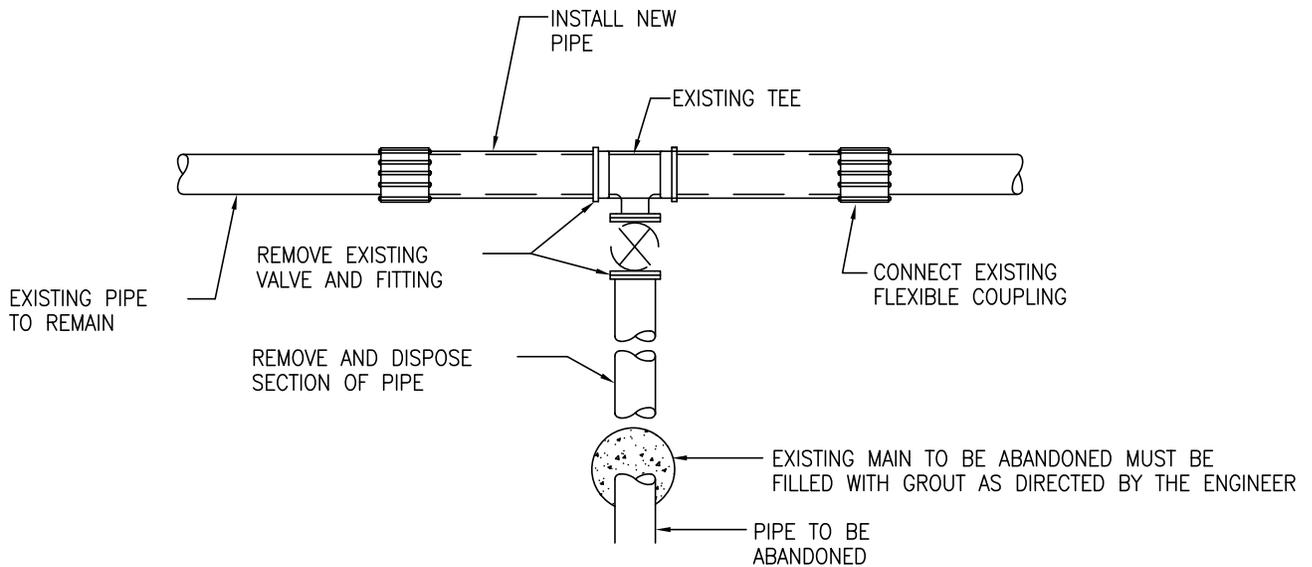


EXISTING PIPE IN SERVICE
(REMOVAL OF FITTINGS W/VALVE)


ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		NOTES		SD-350
REVISED:		SYSTEM		SHEET 1 OF 2
12/17		ABANDONMENT		

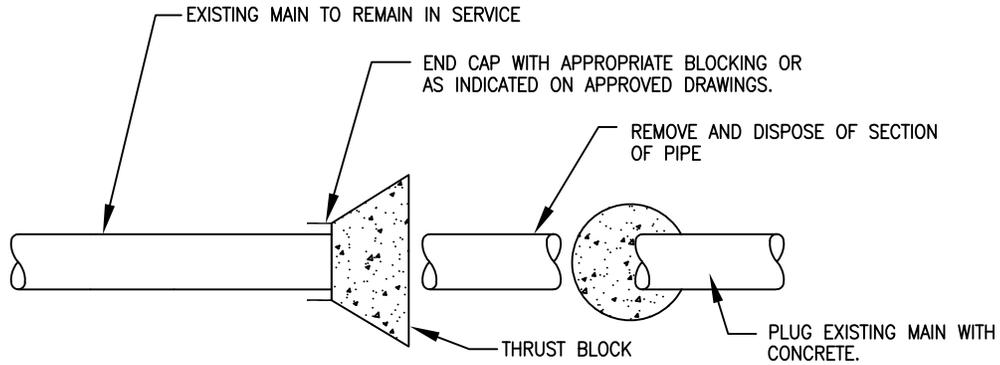

EXISTING PIPE

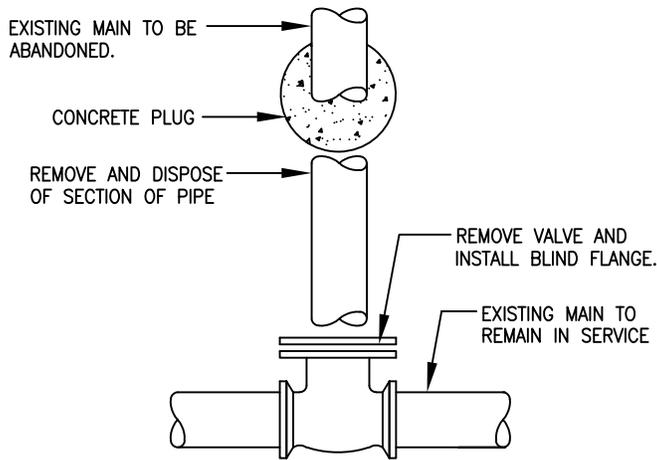

AT FITTING (REMOVAL OF VALVE ONLY)

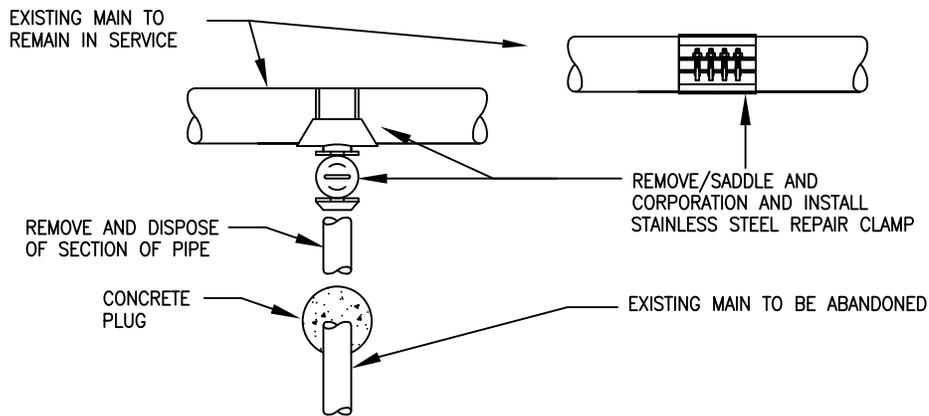

AT CORPORATION
REMOVAL OF WATER SERVICE

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		SYSTEM		SD-350
REVISED:		ABANDONMENT		SHEET 2 OF 2
5/16				