


CONCRETE CYLINDER PIPE (CCP)

NOTES:

1. EXOTHERMIC WELDS SHALL BE INSTALLED ONLY ON BELL.
2. DETAIL APPLICABLE FOR CCP ONLY.


ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		TEST LEAD PLACEMENT		SD-701
REVISED:				
1/17				SHEET 1 OF 3

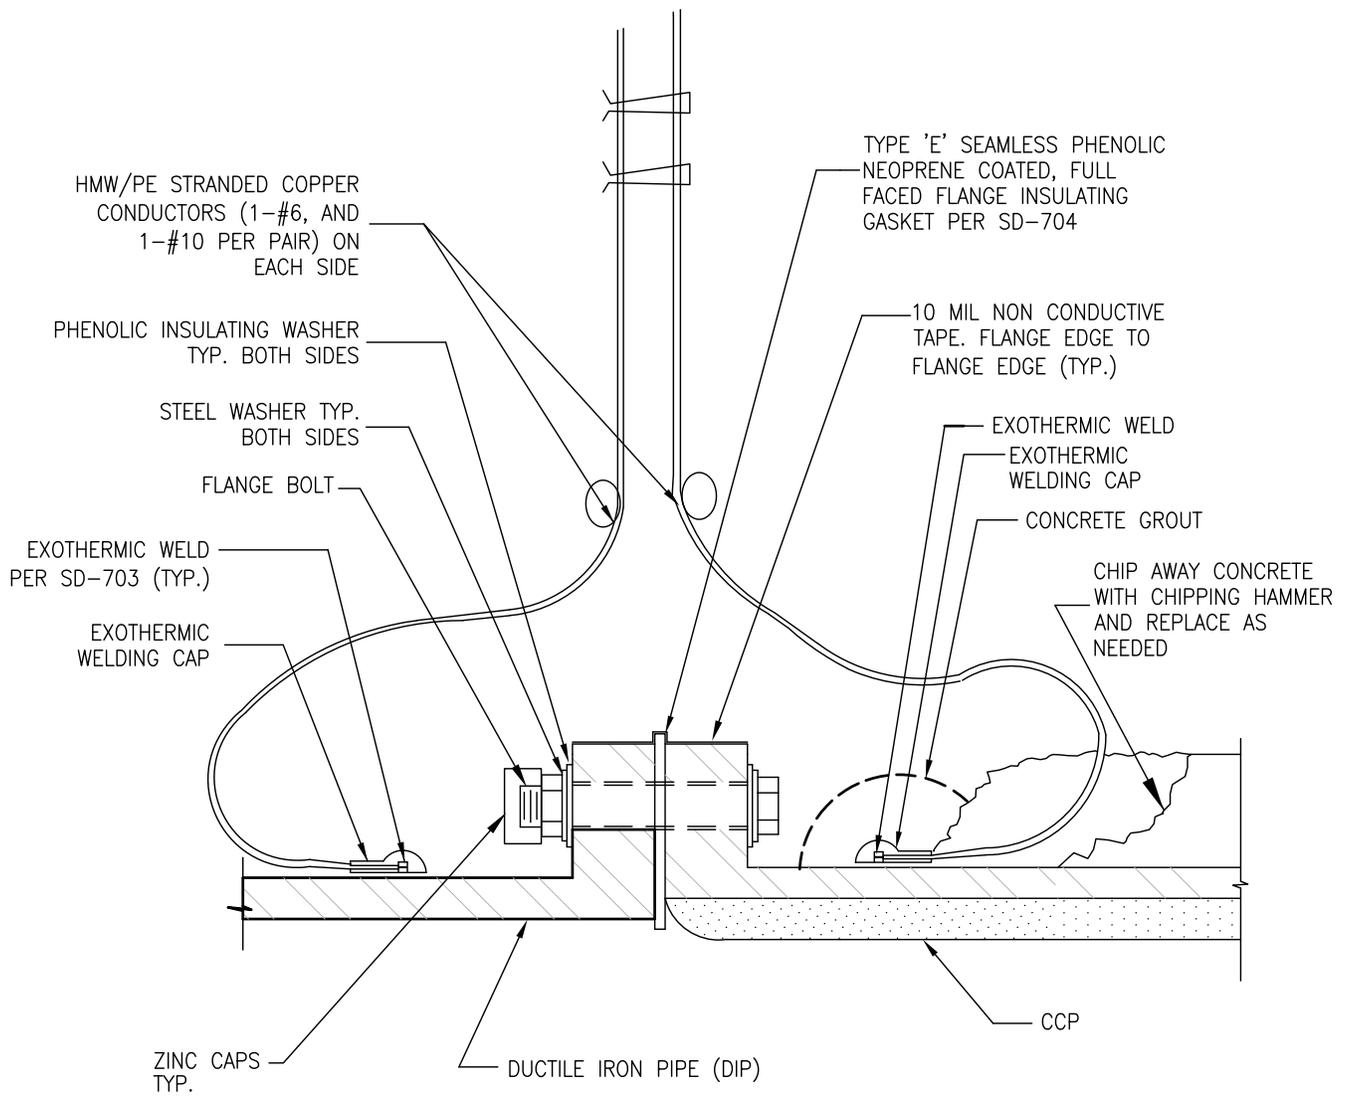

NOTES:

1. EXOTHERMIC WELDING ON FLANGES IS ACCEPTABLE.
2. DETAIL APPLICABLE FOR CCP/DIP ONLY.

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		TEST LEAD PLACEMENT		SD-701
REVISED:				
1/17				

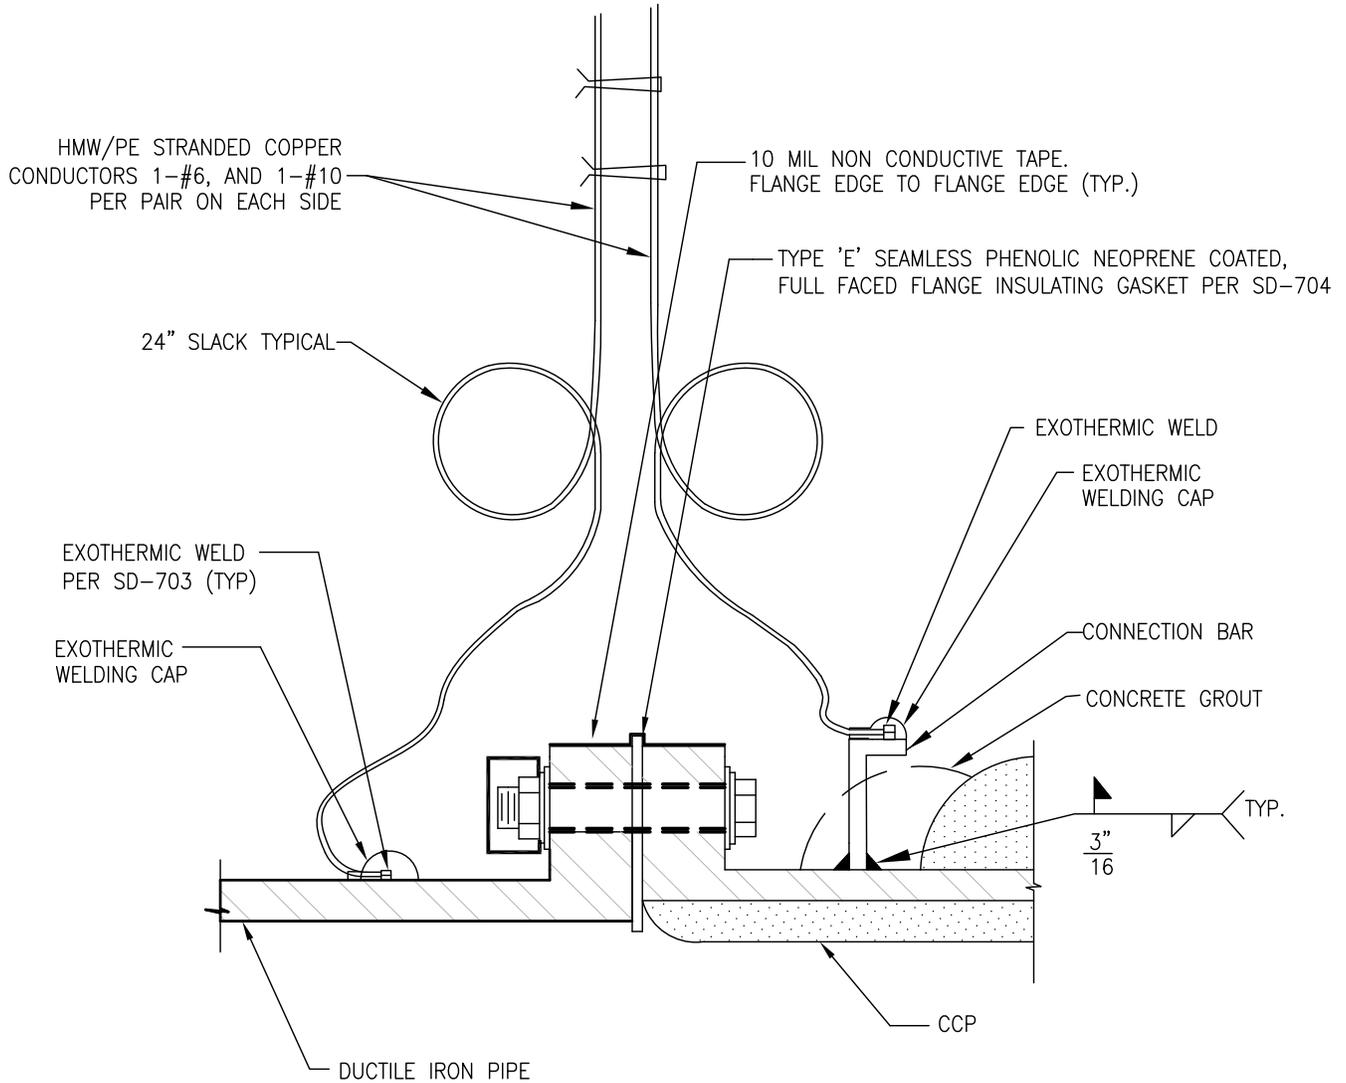

NOTES:

1. CONNECTION BARS DO NOT ELIMINATE NEED FOR CONTINUITY BONDING CLIPS AND/OR BONDING JUMPERS.
2. EXOTHERMIC WELDING ON FLANGES IS ACCEPTABLE.

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		TEST LEAD PLACEMENT		SD-701
REVISED:				SHEET 3 OF 3
1/17				