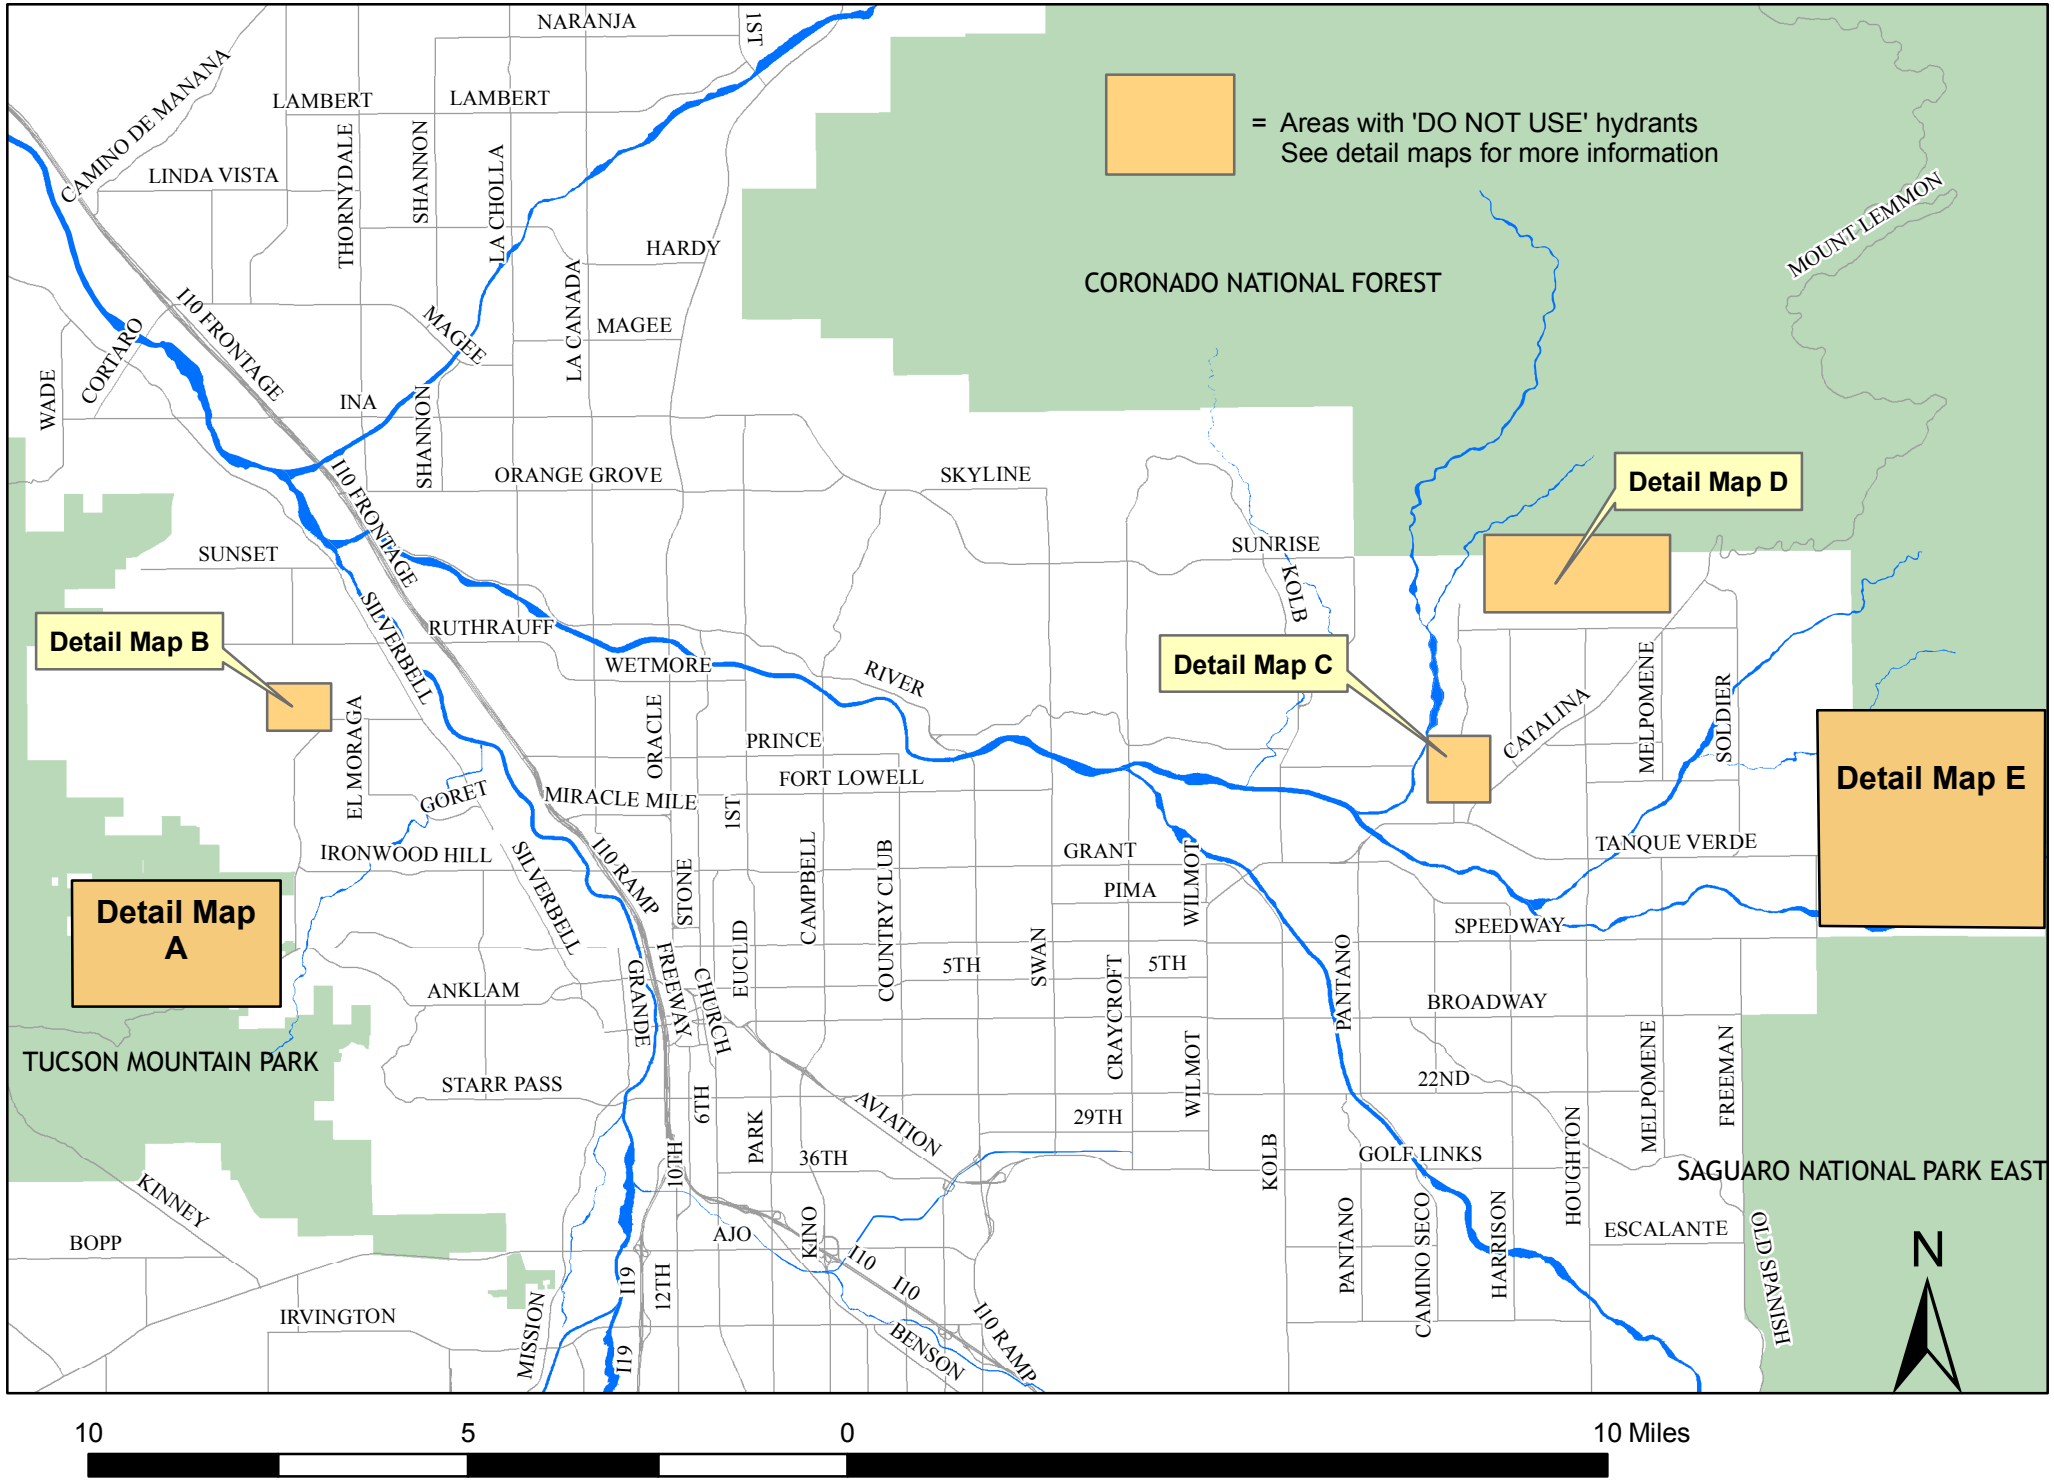Fire Hydrants Unavailable for Construction Water: 2007