


SEE STANDARD SPECIFICATION 1413 AND SD-116

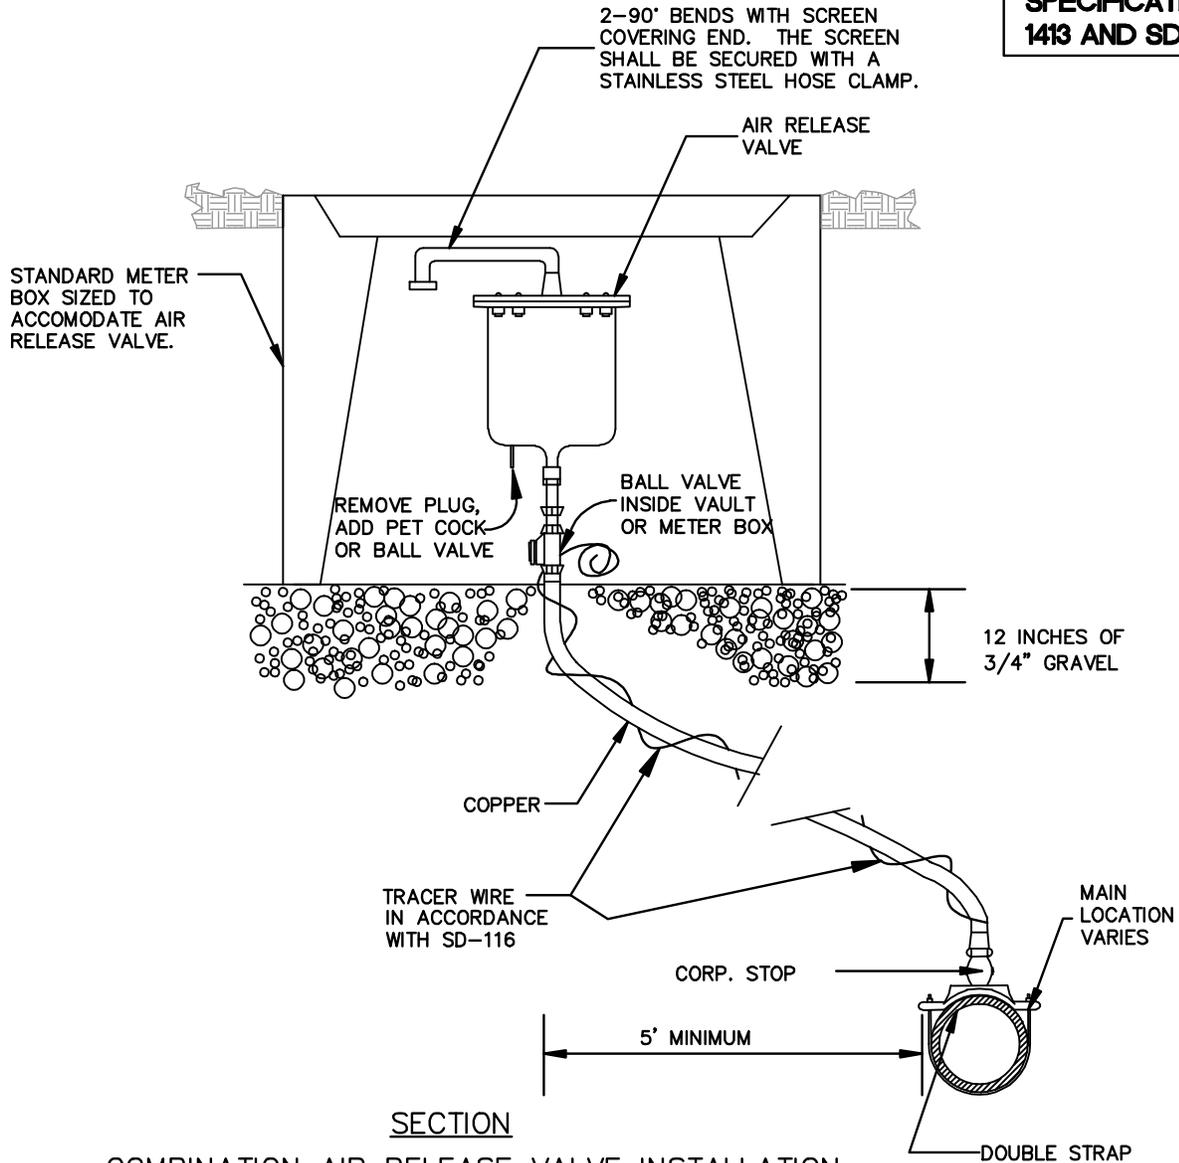

SECTION
COMBINATION AIR RELEASE VALVE INSTALLATION
(FOR ARV 1-INCH)

NOTES:

The post must be of sufficient length to support the ball valve.

Air releases shall be set in a flat strip of land which parallels the curb, sidewalk or watermain. The 3' strip of land shall not exceed the top of curb or sidewalk. Set the air release 8" back of curb in streets with curbs. Set the air release 3' from property line in streets without curbs.

All air release valve installations require a tracer wire. The tracer wire shall be USE, RHW, or RHH solid ten gauge and run in a continuous length from the corporation to the ball valve. The tracer wire shall be attached to the air release line with tape or wire ties at 1' intervals. A 3' coil of wire shall be left in the meter box.

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		AIR RELEASE VALVE INSTALLATION 1"		SD-330
REVISED:				
8/09				SHEET 1 OF 1