


**SEE STANDARD SPECIFICATION 1413, SD-309, SD-116**

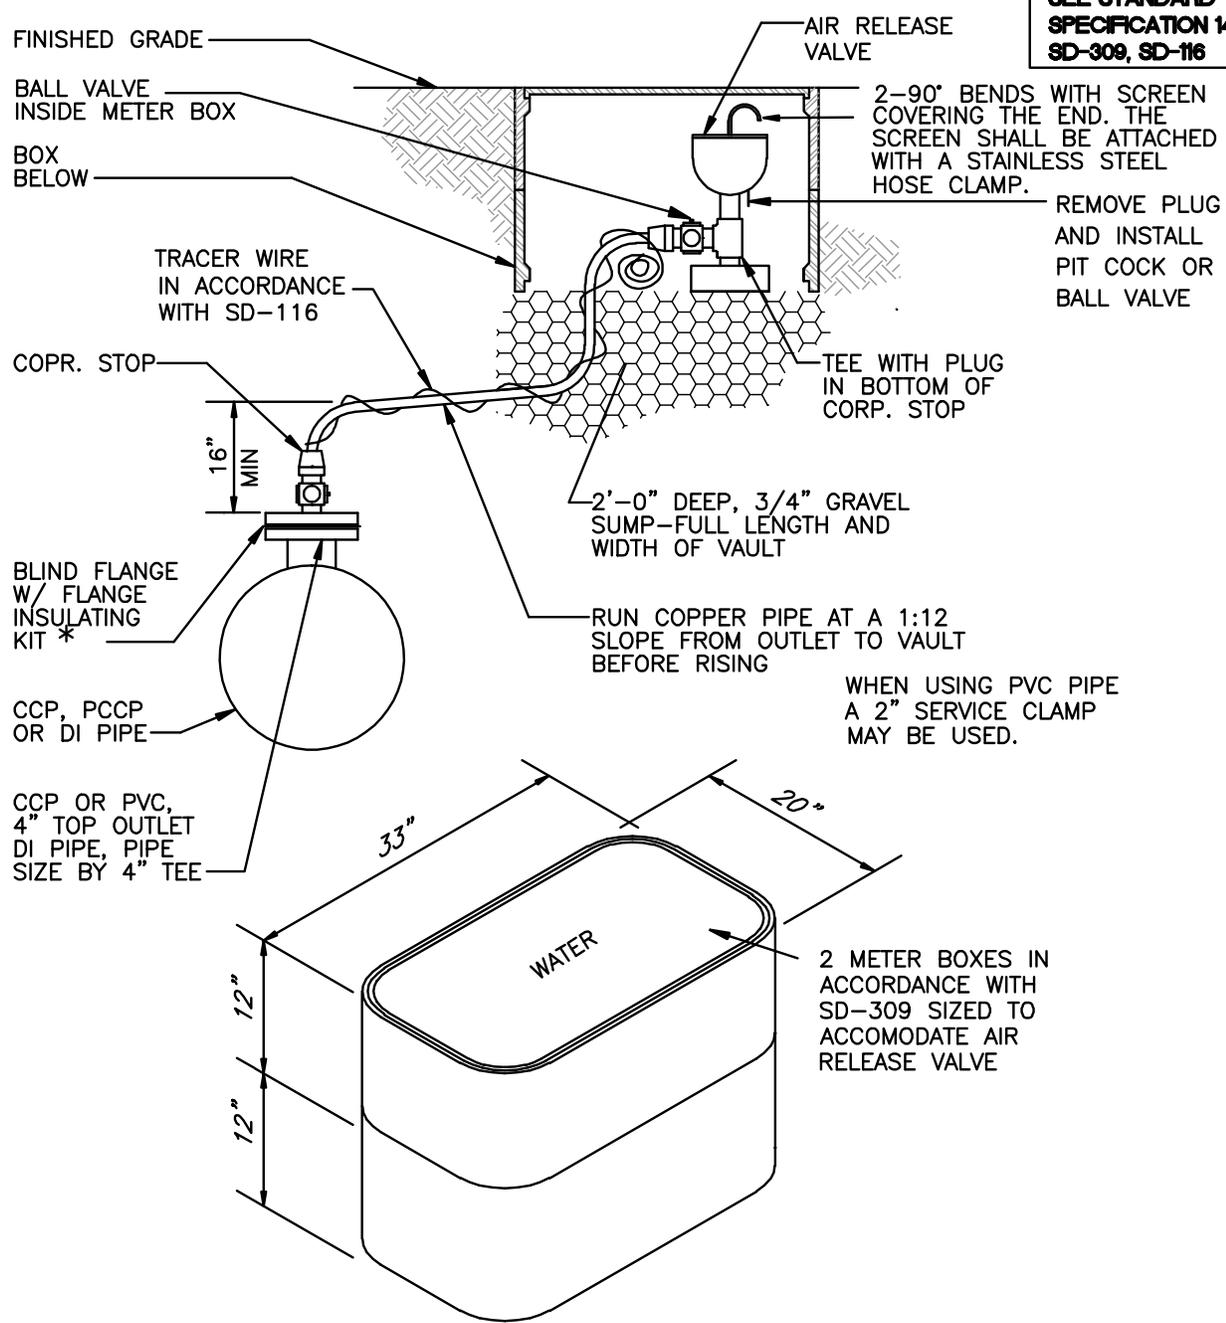

**2" ARV DETAIL**

FOR CCP, HDPE, DIP AND PVC PIPE  
NOT TO SCALE

**\* NOTE**

Flange insulating kit must be tested to confirm isolation prior to backfill. Include test results in final corrosion report.

All air release valve installations require a tracer wire. The tracer wire shall be USE, RHW, or RHH solid 10 gauge and run in a continuous length from the corporation to ball valve. The tracer wire shall be attached to the air release line with tape or wire ties at 1' intervals. A 3' coil of wire shall be left in the meter box.

<b>ISSUED:</b>		<b>STANDARD DETAIL</b>		<b>DETAIL NO.</b>
6/97		<b>AIR RELEASE VALVE INSTALLATION 2"</b>		<b>SD-331</b>
<b>REVISED:</b>				<b>SHEET 1 OF 1</b>
8/09				