
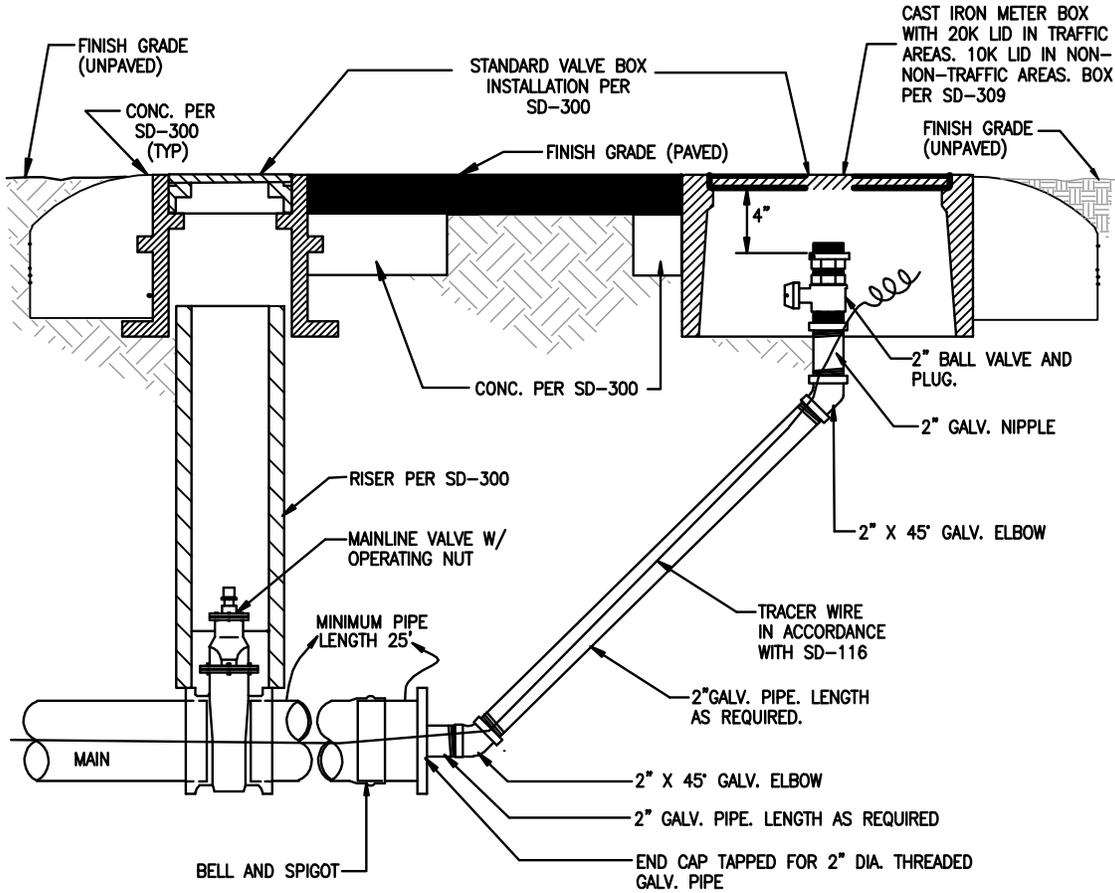


SEE SD-400

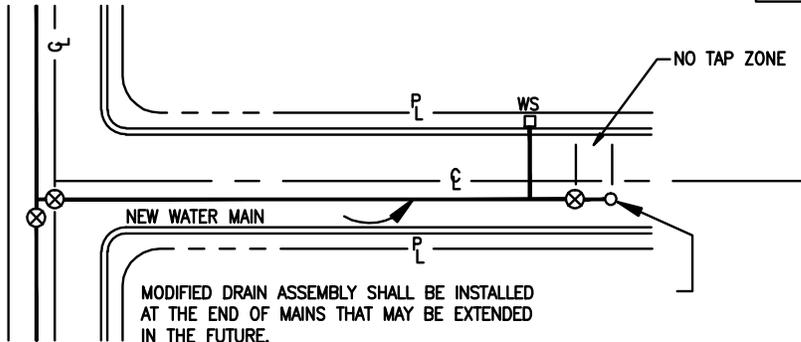

NOTES:

VALVE JOINTS AND END CAP SHALL BE MECHANICALLY RESTRAINED IN ACCORDANCE WITH STANDARD SPECIFICATION 1406.

NO SERVICE TAPS WILL BE ALLOWED BETWEEN THE LINE VALVE AND THE BLOW OFF ASSEMBLY.

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97		MODIFIED DRAIN VALVE ASSEMBLY		SD-405
REVISED:				SHEET 1 OF 1
9/08				