


VALVE BOX AND COVER WITH CONCRETE COLLAR PER SD-300. PLACE FLUSH WITH FINISHED GRADE. "RE" SHALL BE WELDED ON COVER WITH 3" LETTERS.

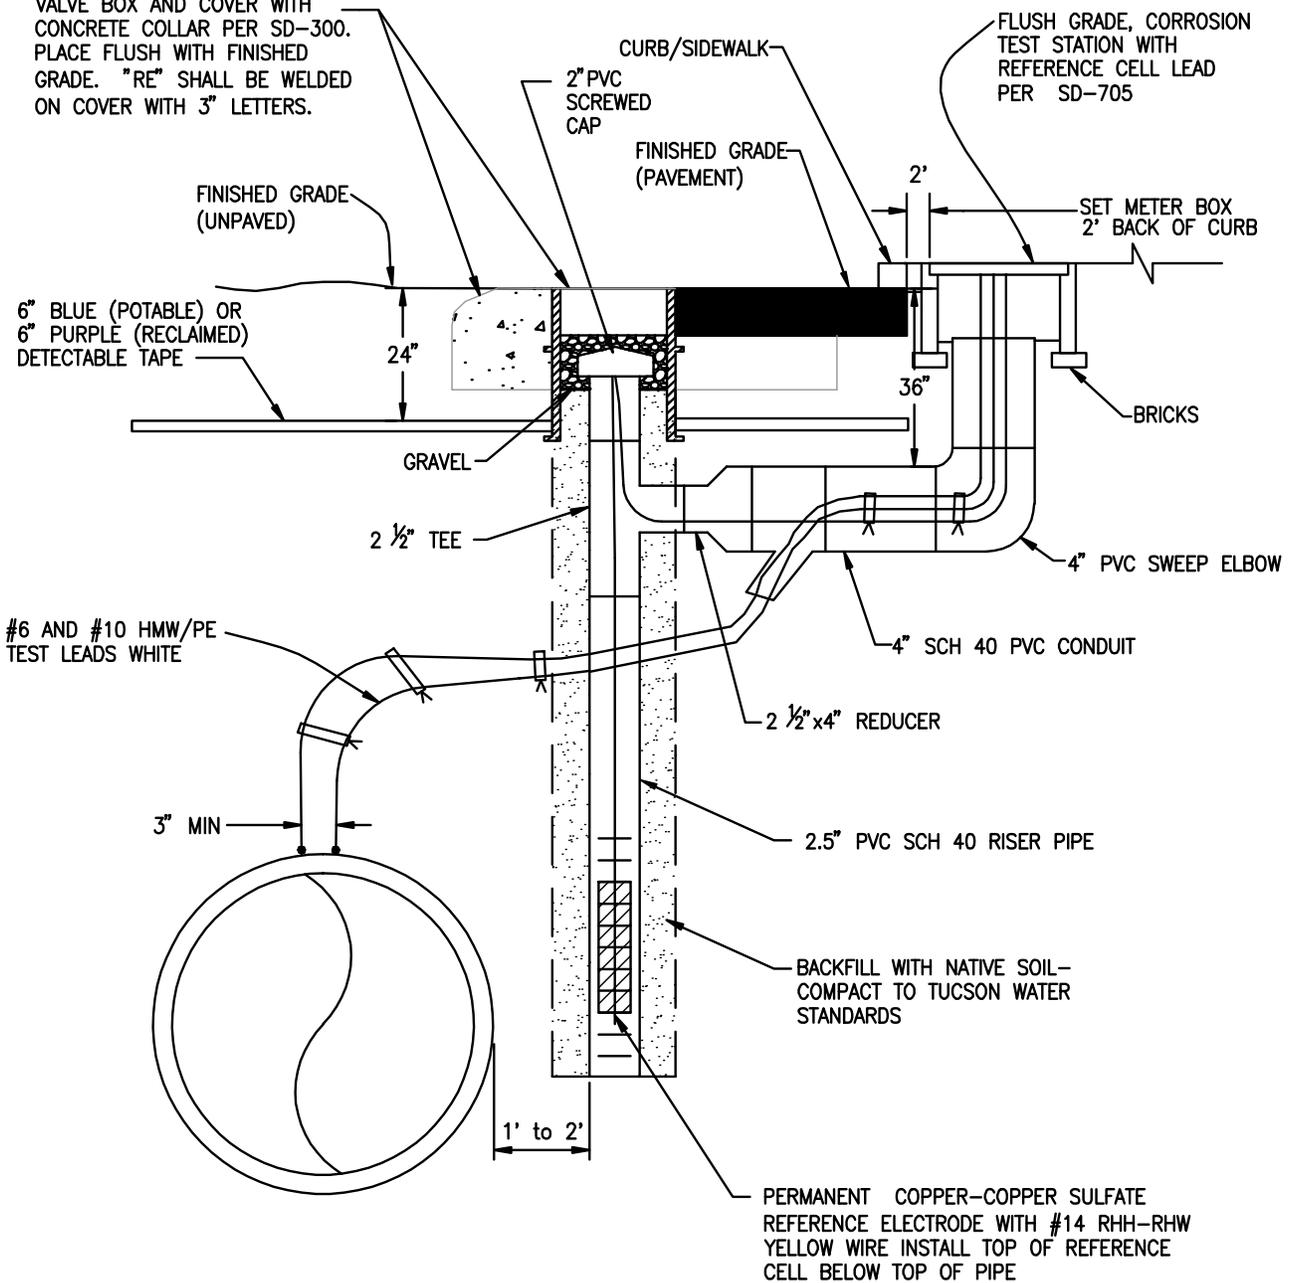

ISSUED:		<b>STANDARD DETAIL PERMANENT REFERENCE ELECTRODE INSTALLATION</b>		DETAIL NO.
6/97				SD-708
REVISED:				SHEET 1 OF 1
10/08				