FAULT CURRENT < 10,000

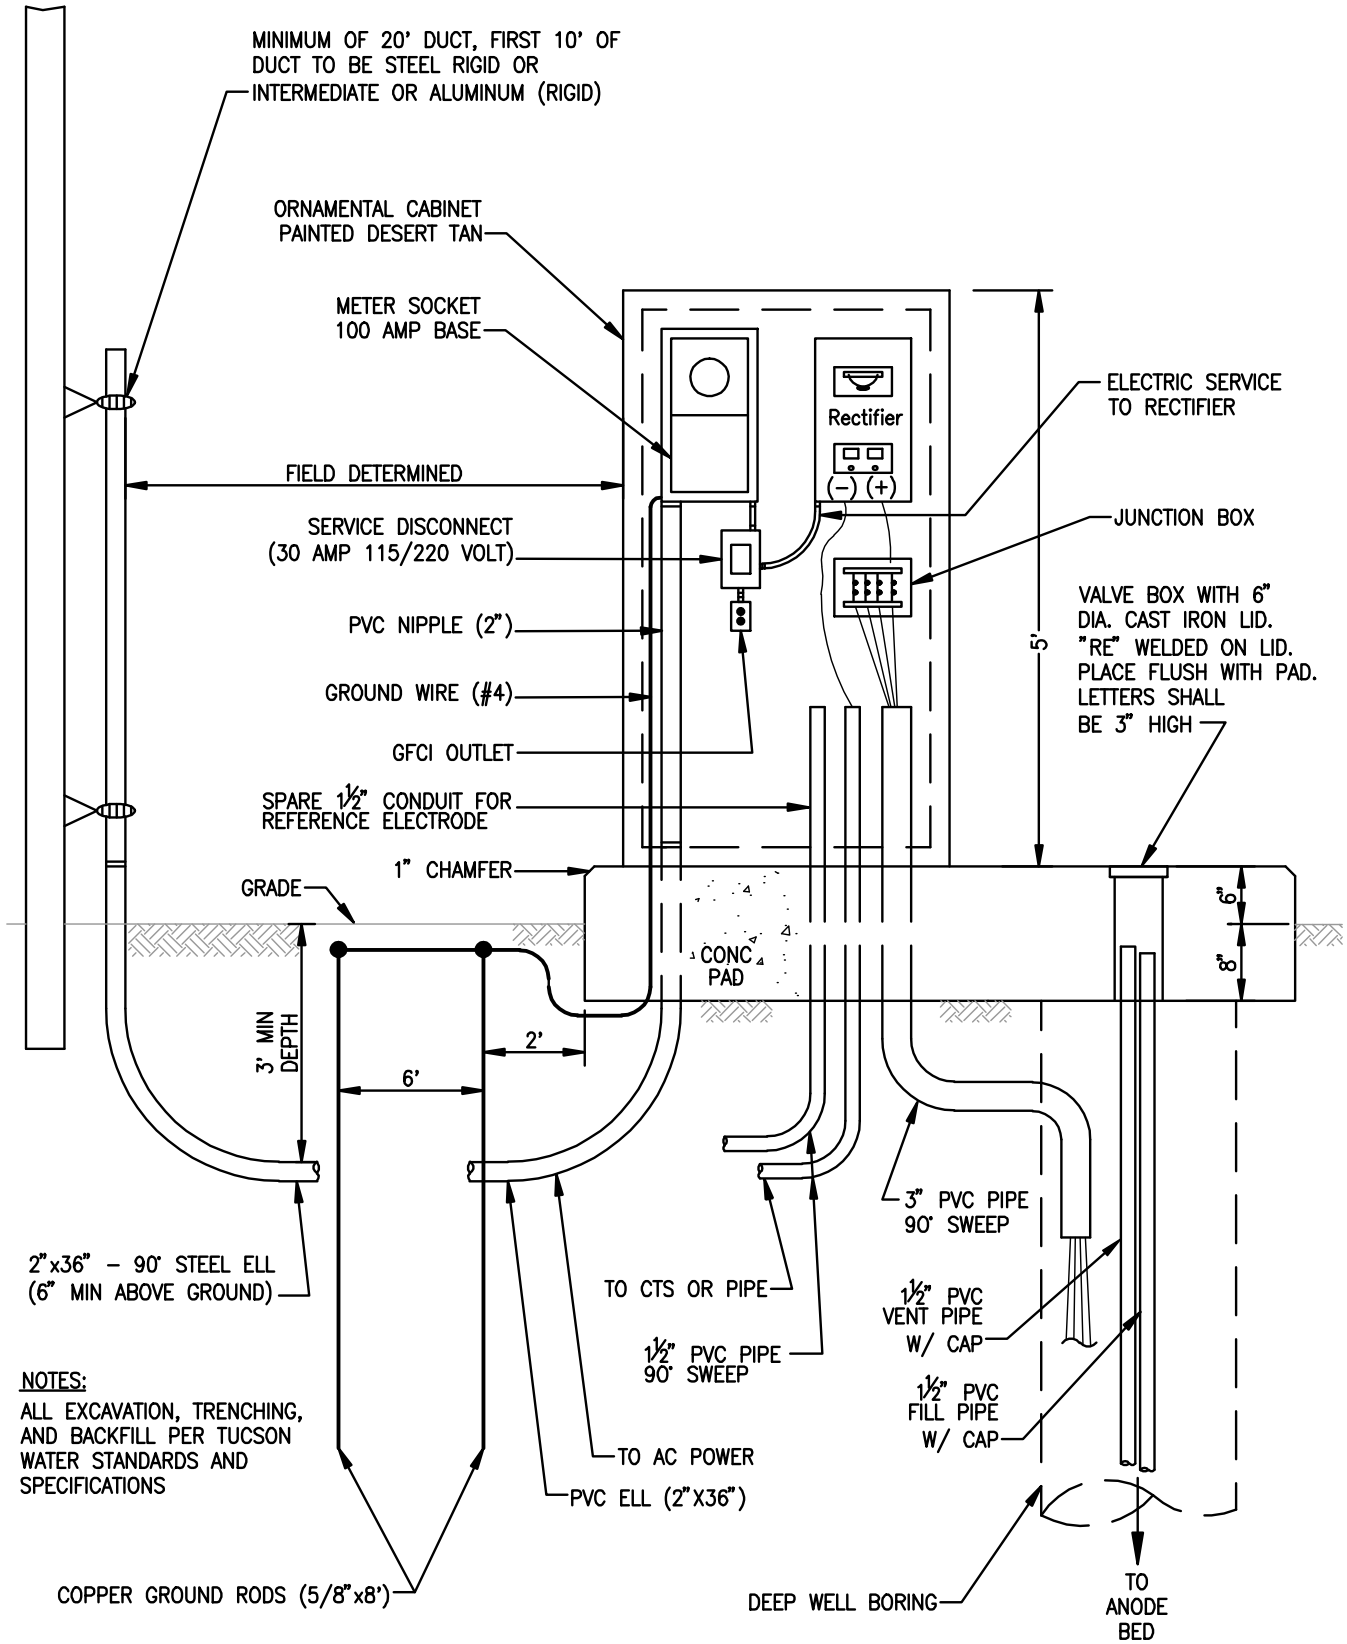

NOTES:

ALL EXCAVATION, TRENCHING, AND BACKFILL PER TUCSON WATER STANDARDS AND SPECIFICATIONS

ISSUED:		STANDARD DETAIL		DETAIL NO.
6/97	TUCSON WATER	CABINET MOUNTED RECTIFIER	TUCSON WATER	SD-711
REVISED:				
10/08				SHEET 1 OF 1